


Connections for Alarm inputs and outputs

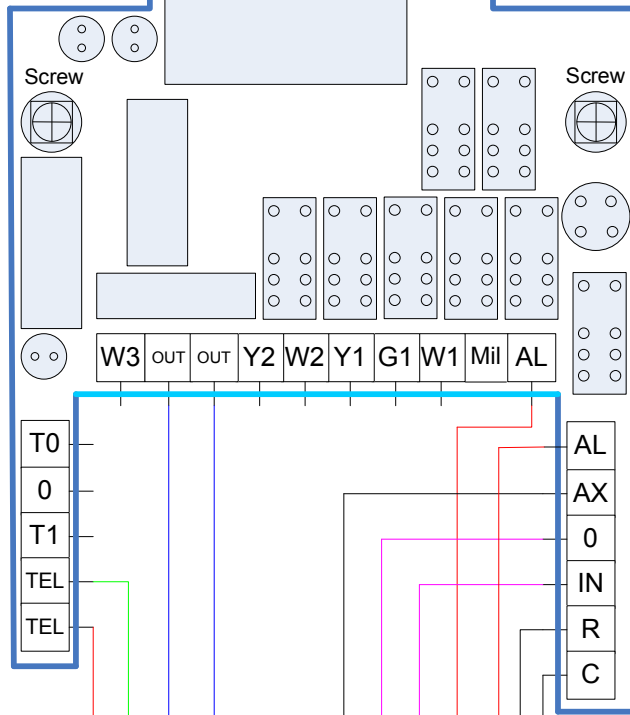

Transformer # PTD2420 (see accessories)


To Phone Jack
 Red
 Green

This contact closes via a command from remote telephone

This contact closes upon an alarm condition such as Hi or Lo temperature

When this input is closed (shorted) an alarm is initiated and dial-out will commence

System Fault input

 Doylestown, PA 18901 USA Phone: 215-766 1487 - Fax: 215-766 1493 Email: info@scillc.com Web: www.scillc.com	Title: CEO-24-HC22[®]			Print name: CEO-24	Drawn :
	Date: 09 Jan 2007			Checksum: 6675	Checked :
	No.	Revision	Date	Software name:	Approved :Ricardo
				File name : CEO-24-HC22	